

FIG. 1

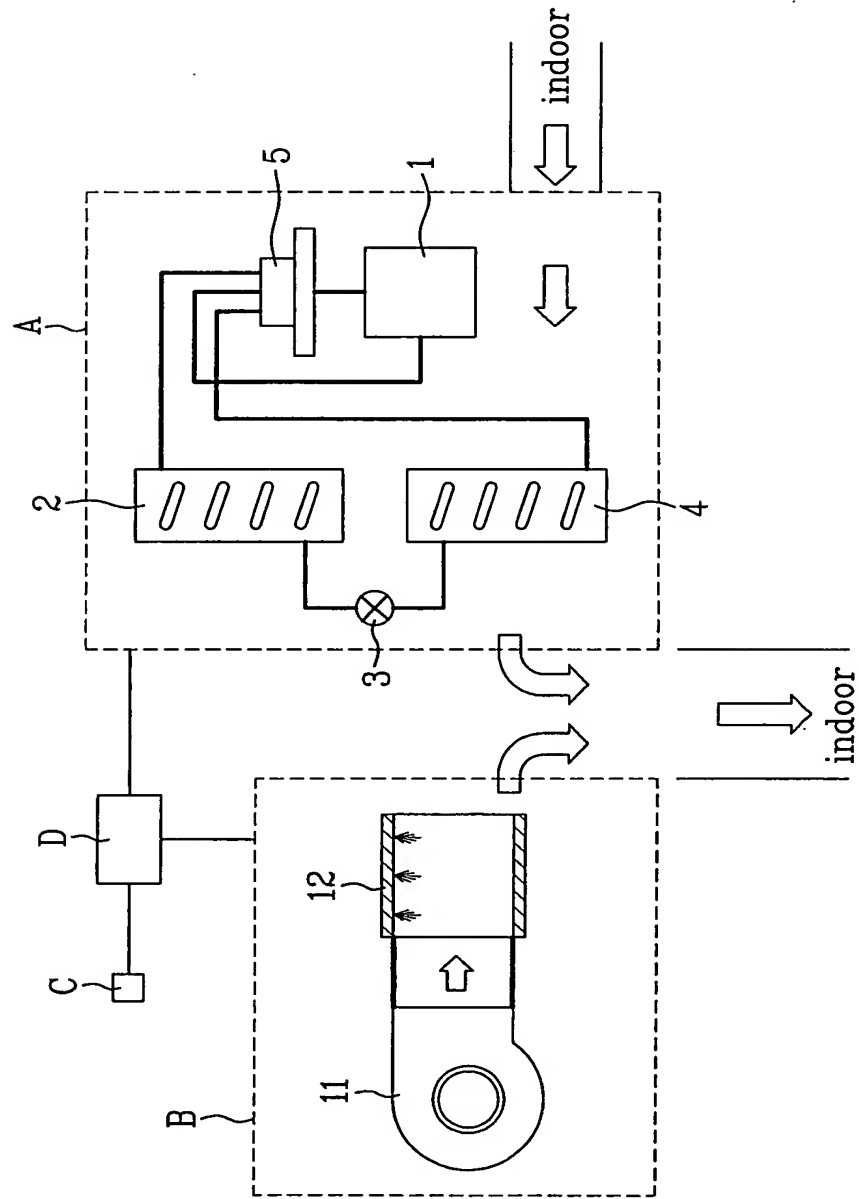


FIG. 2

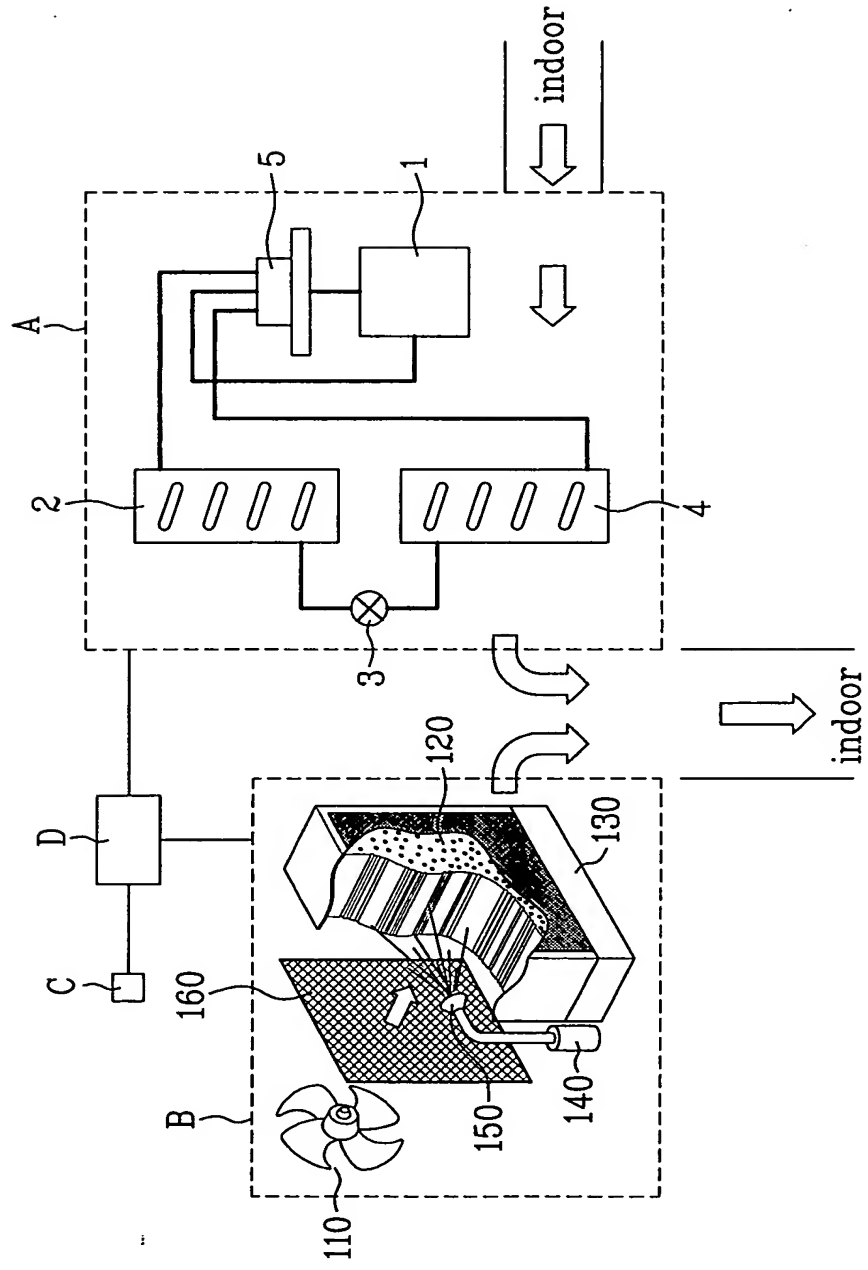


FIG. 3A

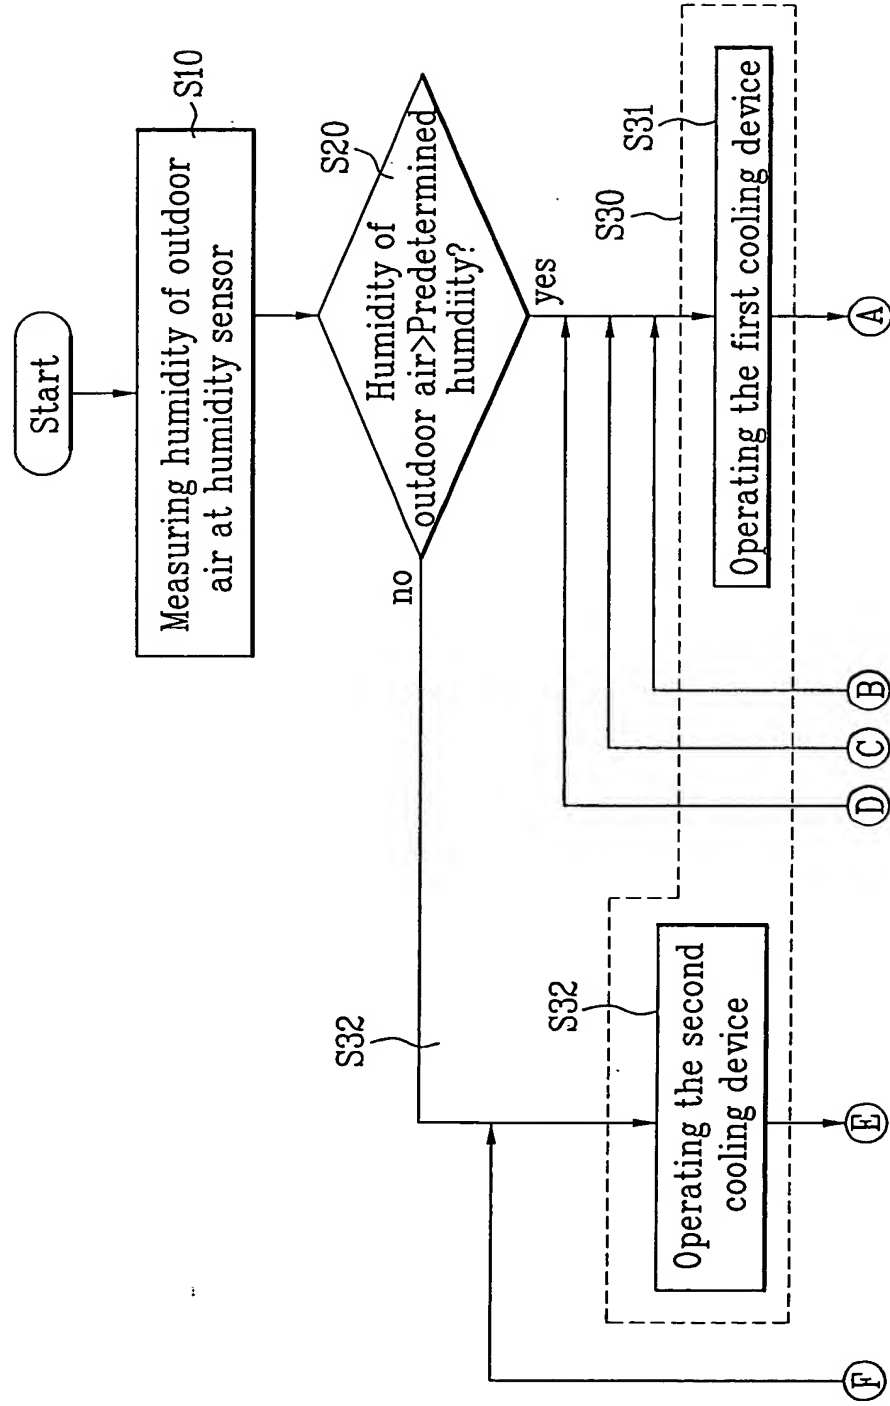


FIG. 3B

```
graph TD
    A((A)) --> S40{Operation time of the first cooling device > Predetermined time?}
    S40 -- yes --> S41[Operating the second cooling device]
    S40 -- no --> B((B))
    S41 --> S42{Operation time of the second cooling device > Predetermined time?}
    S42 -- yes --> S50{Interior temperature < Predetermined temperature?}
    S42 -- no --> D((D))
    S50 -- yes --> S43[Stopping operation of the cooling system]
    S50 -- no --> C((C))
    C --> E((E))
    E --> S60{Operation time of the second cooling device > Predetermined time?}
    S60 -- yes --> S61{Interior temperature > Predetermined temperature?}
    S61 -- yes --> S44[Stopping operating of the second cooling device]
    S61 -- no --> F((F))
    S60 -- no --> F
    S43 --> End([End])
    S44 --> End
```

